
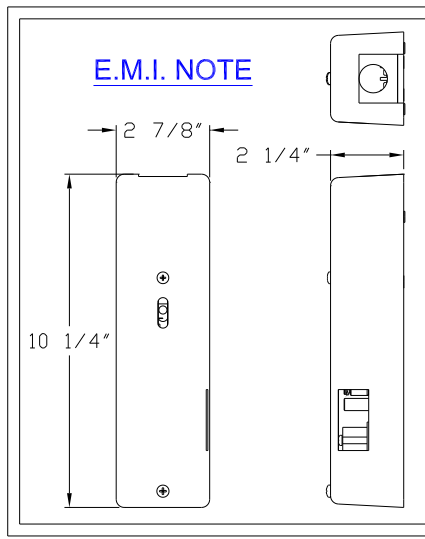


# GENERAL NOTES

**THE FOLLOWING IS TO BE PROVIDED BY THE PURCHASER AND/OR CONTRACTOR UNLESS OTHERWISE SPECIFIED.**

- 1) ELEVATOR TO BE CONSTRUCTED IN ACCORDANCE WITH ASME A17.1 PART 5.3 AND ALL LOCAL CODES.
- 2) ELECTRICAL REQUIREMENTS ARE BY OTHERS AS FOLLOWS:
  - 3 POLE DISCONNECT SWITCH
  - 230 VAC 25 AMP CIRCUIT 1 PHASE FUSED WITH 25 AMP CLASS CC FUSE TO BE INSTALLED IN A LOCKABLE FUSED DISCONNECT.
  - 120 VAC 15 AMP CIRCUIT 1 PHASE WITH 15 AMP PROTECTION
- 3) A MINIMUM OF ONE HOISTWAY DOOR, ENTRANCE, AND ASSOCIATED FRAMING SHALL BE LEFT UNFINISHED UNTIL THE ELEVATOR IS SET IN PLACE.
- 4) HOISTWAY MUST BE PLUM WITHIN 1/8 INCH PER 10 FT OF HEIGHT AND SQUARE AT ANY POINT WITHIN 1/4 INCH BASED ON DIFFERENCE IN DIAGONAL MEASUREMENTS.
- 5) MACHINE ROOM MUST BE PROVIDED FOR THE OPERATING EQUIPMENT THAT MEETS N.E.C. CLEAR SPACE REQUIREMENTS AND ALL LOCAL CODES. MACHINE ROOM MUST HAVE A LIGHT AND A CONVENIENCE OUTLET. TEMPERATURE IN MACHINE ROOM TO BE MAINTAINED BETWEEN 60-110° F AND RELATIVE HUMIDITY SHOULD NOT EXCEED 95%.
- 6) CODE REQUIRES A TELEPHONE CONNECTION TO THE ELEVATOR CAR THEREFORE, A PHONE LINE MUST BE INSTALLED IN THE MACHINE ROOM.
- 7) ALL HOISTWAY DOORS REQUIRE AN INTERLOCK, DOOR HANDLE, AND LATCH SET.
- 8) ANY ALTERATIONS TO THE EQUIPMENT WITHOUT WRITTEN AUTHORIZATION BY WAUPACA ELEVATOR WILL VOID ALL WARRANTIES.
- 9) STRUCTURE MUST BE CAPABLE OF SUPPORTING THE APPROPRIATE LOADS. LOCAL ENGINEERING SUPPORT IS RECOMMENDED.
- 10) WHEN USED, CONCRETE MUST BE A MINIMUM OF 4" THICK 3500 PSI.
- 11) LOAD ON PIT FLOOR IS 4750 LBS. (MINIMUM PIT DEPTH OF 8")

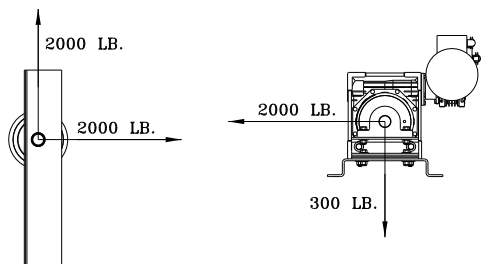

## GENERAL SPECIFICATIONS

RATED LOAD (CAPACITY):	1000 LBS.	SPEED:	40 FPM
WEIGHT OF CAB,GATE(S),AND FIXTURES SHALL NOT EXCEED 600LBS.			
SUSPENSION ROPE:	(2) 3/8-8x19 TRACTION STEEL FC		
GUIDE RAIL:	T RAIL CONFIGURATION		
GEAR BOX RATIO:	100:1		
DRUM DIAMETER:	7.875 in.		
MOTOR:	3 HP 230 VOLTS 8.6 FLA 60 HZ 3PH		
CAB LIGHT CIRCUIT:	120V, 15A		
CAB ALARM BELL:	ALARM W/BATTERY		
CAB MODEL:			
CAB SIZE:			
TRAVEL:		NUMBER OF STOPS:	
HOISTWAY DOOR INTERLOCKS:			
CONTROLLER SIZE:	24" x 18" x 8"	BATTERY BOX SIZE:	16" x 12" x 8"

WE

**WAUPACA  
ELEVATOR CO., INC.**

Residential Elevators \* Wheelchair-Compatible Elevators  
RESIDENTIAL AND COMMERCIAL DUMBWAITERS

1726 North Ballard Road  
Appleton, WI 54911  
Phone: 800-238-8739

CUSTOMER:		
CONTRACTOR:		
TITLE: (021/022) T-RAIL WINDING DRUM NOTES & SPECIFICATIONS 1000 LB. CAPACITY		
QUOTE NUMBER:		
DRAWN BY:	SCALE:	DWG. NO.
APPD:	DATE:	C-002829