





# SELECT CEDARMILL® - SMOOTH - BEADED SELECT CEDARMILL®

IMPORTANT: FAILURE TO INSTALL AND FINISH THIS PRODUCT IN ACCORDANCE WITH APPLICABLE BUILDING CODES AND JAMES HARDIE WRITTEN APPLICATION INSTRUCTIONS MAY LEAD TO PERSONAL INJURY, AFFECT SYSTEM PERFORMANCE, VIOLATE LOCAL BUILDING CODES, AND VOID THE PRODUCT ONLY WARRANTY. BEFORE INSTALLATION, CONFIRM THAT YOU ARE USING THE CORRECT HARDIEZONE INSTRUCTIONS. TO DETERMINE WHICH HARDIEZONE APPLIES TO YOUR LOCATION, VISIT WWW.HARDIEZONE.COM OR CALL 1-866-942-7343 (866 9HARDIE)

### STORAGE & HANDLING:

Store flat and keep dry and covered prior to installation. Installing siding wet or saturated may result in shrinkage at butt joints. Carry planks on edge. Protect edges and corners from breakage. James Hardie is not

responsible for damage caused by improper storage and handling of the product.

#### **OUTDOORS** 1. Position cutting station so that wind will blow dust away from user and others in working area.

2. Use one of the following methods: a. Best:

i. Score and snap ii. Shears (manual, electric or pneumatic)

i. Dust reducing circular saw equipped with a

HardieBlade® saw blade and HEPA vacuum extraction i. Dust reducing circular saw with a HardieBlade saw blade

(only use for low to moderate cutting)

**CUTTING INSTRUCTIONS** 

- 1. Cut only using score and snap, or shears (manual, electric or pneumatic). 2. Position cutting station in well-ventilated area
- NEVER use a power saw indoors
- NEVER use a circular saw blade that does not carry the HardieBlade saw blade trademark

NEVER dry sweep - Use wet suppression or HEPA Vacuum

Important Note: For maximum protection (lowest respirable dust production), James Hardie recommends always using "Best"-level cutting methods where feasible.


NIOSH-approved respirators can be used in conjunction with above cutting practices to further reduce dust exposures. Additional exposure information is available at www.jameshardie.com to help you determine the most appropriate cutting method for your job requirements. If concern still exists about exposure levels or you do not comply with the above practices, you should always consult a qualified industrial hygienist or contact James Hardie for further information.

# IMPORTANT: To prevent damage to the drip edge, extra care should be taken when removing planks from the pallet, while handling, and when installing with a lap gauge. Please see additional handling requirements on page 4. GENERAL REQUIREMENTS:

- References to the 2005 National Building Code (NBC) of Canada are made throughout this document. Local building code requirements may supersede the NBC in some locations.
- · Where local building code requires a capillary break (Rainscreens, Furring, Etc.), fastener specifications per the CCMC can still be used as long as the required fastener penetration is achieved into an approved nailable substrate.
- HardiePlank® lap siding can be installed over braced wood or steel studs spaced a maximum of 610mm (24") o.c. or directly to minimum 11.1mm (7/16") thick OSB sheathing\*. Irregularities in framing and sheathing can mirror through the finished application. HardiePlank lap siding can also be installed over furring strips (in accordance with local building code requirements).
- HardiePlank lap siding can also be installed over foam insulation/sheathing up to 25mm (1") thick. When using foam insulation/sheathing, avoid over-driving nails (fasteners), which can result in dimpling of the siding due to the compressible nature of the foam insulation/sheathing. Extra caution is necessary if power-driven nails (fasteners) are used for attaching siding over foam insulation/sheathing. Figure 1 Double Wall Single Wall Construction
- A water-resistive barrier is required in accordance with Part 9.27.3.2 of the NBC. The water-resistive barrier must be appropriately installed with penetration and junction flashing in accordance with Part 9.27.3 of the NBC. James Hardie will assume no responsibility for water infiltration.
- When installing James Hardie products all clearance details in figs. 3, 4, 5, 6, 7, 8 & 9 must be followed.
- Adjacent finished grade must slope away from the building in accordance with local building codes.
- Do not use HardiePlank® lap siding in Fascia or Trim applications.
- Do not install James Hardie products, such that they may remain in contact with standing water.
- HardiePlank lap siding may be installed on flat vertical wall applications only.
- DO NOT use stain on James Hardie® products

# **INSTALLATION:** JOINT TREATMENT+

(Required for ColorPlus® Finish, Recommended for Primed product) James Hardie does not recommend the use of caulk at field butt joints. Install factory finished edges together at butt joints.



Nail line<sup>†</sup> (If nail line is not present place fastener between 19mm (3/4") & 25mm (1") from top of plank)

resistive Install a 32mm (1 1/4") starter leave appropriate gap between planks and trim, then caulk\*\*\* strip to ensure a consistent plank angle

tive barrier

plywood or OSB sheathing

610mm (24")

† For other jointing options, refer to local building code

\*If only nailed directly to sheathing, plank can be a maximum 8 1/2" wide and must be face nailed at 305mm (12") o.c. or less with 2.3mm shank x 5.7mm HD x 38mm (1.5") long corrosion resistant nails. \*\*\*Apply caulk in accordance with caulk manufacturers written application instructions \*\*As required by local building code

#### WARNING: AVOID BREATHING SILICA DUST

James Hardie® products contain respirable crystalline silica, which is known to the State of California to cause cancer and is considered by IARC and NIOSH to be a cause of cancer from some occupational sources. Breathing excessive amounts of respirable silica dust can also cause a disabling and potentially fatal lung disease called silicosis, and has been linked with other diseases. Some studies suggest smoking may increase these risks. During installation or handling: (1) work in outdoor areas with ample ventilation; (2) use fiber cement shears for cutting or, where not feasible, use a HardieBlade blade and dust-reducing circular saw attached to a HEPA vacuum, (3) warn others in the immediate area; (4) wear a properly-fitted, NIOSH-approved dust mask or respirator (e.g. N-95) in accordance with applicable government regulations and manufacturer instructions to further limit respirable silica exposures. During clean-up, use HEPA vacuums or wet cleanup methods - never dry sweep. For further information, refer to our installation instructions and Material Safety Data Sheet available at www.jameshardie.com or by calling 1-800-9HARDIE (1-800-942-7343). FAILURE TO ADHERE TO OUR WARNINGS, MSDS, AND INSTALLATION INSTRUCTIONS MAY LEAD TO SERIOUS PERSONAL INJURY OR DEATH




#### **CLEARANCES**

Install siding and trim products in compliance of Part 9.27.2.4 of the NBC which requires a minimum 200mm (8") for clearance between the James Hardie® products and bottom edge of the siding and the adjacent finished grade.

Figure 3 water-resistive barrie concrete foundation HardiePlank® 00mm lap siding


Maintain a 50mm (2") mininum clearance between paths, steps and driveways.




Maintain a 50mm (2") minimum clearance between James Hardie products and decking material.

Figure 5 water barrier deck material joist ledger


At the juncture of the roof and vertical surfaces, flashing and counterflashing shall be installed per the roofing manufacturer's instructions. Part 9.27.2.4 requires a minimum 50mm (2") clearance between the roofing and the bottom edge of the siding and trim.



Maintain a 6mm (1/4") clearance between the bottom of James Hardie products and horizontal flashing. Do not caulk gap.



Maintain a minimum 25mm (1") gap between gutter end caps and siding & trim.



# Figure 9 Step flashing Self-adherii Self-adhering - Drip edge Housewrap

### KICKOUT FLASHING

Because of the volume of water that can pour down a sloped roof, one of the most critical flashing details occurs where a roof intersects a sidewall. The roof must be flashed with step flashing. Where the roof terminates, install a kickout to deflect water away from the siding.

It is best to install a self-adhering membrane on the wall before the subfascia and trim boards are nailed in place, and then come back to install the kickout.

**Figure 9. Kickout Flashing**<sup>‡</sup> To prevent water from dumping behind the siding and the end of the roof intersection, install a "kickout" of sufficient length and angle to direct the water running down the roof away from the siding.

### **FASTENER REQUIREMENTS\*\***

Blind Nailing is the preferred method of installation for all HardiePlank® lap siding products

### **BLIND NAILING**

# Corrosion Resistant Nails (galvanized or stainless steel)

- Roofing nail (3 mm shank x 9.5 mm HD x 32 mm (1 1/4") long)
- Minimum Requirement: Siding nail (2.4 mm shank x 5.6 mm HD x 50 mm (2") long)

#### **Corrosion Resistant Screws**

 Ribbed wafer-head or equivalent (No. 8 x 9.5 mm HD x 32 mm (1 1/4") long). Screws must penetrate 6 mm or 3 full threads into metal framing.

#### **Corrosion Resistant Fasteners**

ET & F Panelfast (2.5mm shank x 8mm HD x 38mm (1 1/2") long)

Face Nailing should only be used where required for high wind areas and must not be used in conjunction with Blind Nailing

### **FACE NAILING**

#### Corrosion Resistant Nails (galvanized or stainless steel)

- 6d common nail (2.9 mm shank x 6.7 mm HD x 50 mm (2") long)
- Siding nail (2.3 mm shank x 5.6 mm HD x 50 mm (2") long)
- Siding nail (2.3 mm shank x 5.6 mm HD x 38 mm (1 1/2") long)\*

#### **Corrosion Resistant Screws**


Ribbed bugle-head or equivalent

(No. 8-18 x 8.2 mm HD x 41 mm (1 5/8") long).

Screws must penetrate 6 mm or 3 threads into metal framing.

#### Corrosion Resistant Fasteners

ET & F pin (2.5mm shank x 6.4mm HD x 38mm (1 1/2") long)

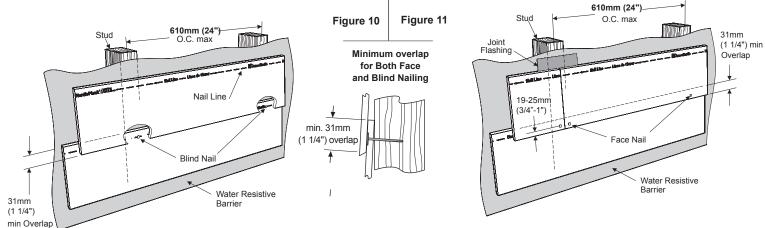

Laminate sheet to be removed immediately after installation of each course for ColorPlus® products.

- # The illustration (figure 9) and associated text was reprinted with permission of THE JOURNAL OF LIGHT CONSTRUCTION. For subscription information, visit www.jlconline.com
- When face nailing to OSB, planks must be no greater than 8 1/4" wide and fasteners must be 305mm (12") o.c. or less.
- \*\* Also see General Fastening Requirements.





# **GENERAL FASTENING REQUIREMENTS**

Fasteners must be corrosion resistant, galvanized, or stainless steel. Electro-galvanized are acceptable but may exhibit premature corrosion. James Hardie recommends the use of quality, hot-dipped galvanized nails. James Hardie is not responsible for the corrosion resistance of fasteners. Stainless steel fasteners are recommended when installing James Hardie® products near the ocean, large bodies of water, or in very humid climates.

# PNEUMATIC FASTENING

James Hardie products can be hand nailed or fastened with a pneumatic tool. Pneumatic fastening is highly recommended. Set air pressure so that the fastener is driven snug with the surface of the siding. A flush mount attachment on the pneumatic tool is recommended. This will help control the depth the nail is driven. If setting the nail depth proves difficult, choose a setting that under drives the nail. (Drive under driven nails snug with a smooth faced hammer - Does not apply for installation to steel framing).

- Consult applicable code compliance report for correct fasteners type and placement to achieve specified design wind loads.
- NOTE: Published wind loads may not be applicable to all areas where Local Building Codes have specific jurisdiction. Consult James Hardie Technical Services if you are unsure of applicable compliance documentation.
- Drive fasteners perpendicular to siding and framing.
- Fastener heads should fit snug against siding (no air space). (fig. A)
- Do not over-drive nail heads or drive nails at an angle.
- If nail is countersunk, caulk nail hole and add a nail. (fig. B)
- For wood framing, under driven nails should be hit flush to the plank with a hammer (For steel framing, remove and replace nail).
- Do not use aluminum fasteners, staples, or clipped head nails.

Snug









# **CUT EDGE TREATMENT**

All field cut edges must be painted or primed.

#### CAULKING

A high quality, paintable caulk is required in accordance with Part 9.27.4 of the NBC. For best results use a sealant that complies with either ASTM C 834 or ASTM C 920 (Grade NS, Class 25). Caulking must be applied in accordance with caulking manufacturers written instructions.

#### **PAINTING**

DO NOT use stain on James Hardie® products. James Hardie products must be painted within 180 days for primed product and 90 days for unprimed. 100% acrylic topcoats are recommended. Do not paint when wet. For application rates refer to paint manufacturers specifications. Back-rolling is recommended if the siding is sprayed.

# COLORPLUS® TECHNOLOGY CAULKING, TOUCH-UP & LAMINATE

- Touch up nicks, scrapes and nail heads using the ColorPlus® Technology touch-up applicator. Touch-up paint should be used sparingly. If large areas require touch-up, replace the damaged area with new HardiePlank® lap siding with ColorPlus Technology.
- Laminate sheet must be removed immediately after installation of each course.
- Terminate non-factory cut edges into trim where possible, and caulk. Color matched caulks are available from your ColorPlus® product dealer.
- Treat all other non-factory cut edges using the ColorPlus Technology edge coaters, available from your ColorPlus product dealer.

# PAINTING JAMES HARDIE® SIDING AND TRIM PRODUCTS WITH COLORPLUS® TECHNOLOGY

When repainting ColorPlus products, James Hardie recommends the following regarding surface preparation and topcoat application:

- Ensure the surface is clean, dry, and free of any dust, dirt, or mildew
- · Repriming is normally not necessary
- 100% acrylic topcoats are recommended
- DO NOT use stain or oil/alkyd base paints on James Hardie® products
- Apply finish coat in accordance with paint manufacturers written instructions regarding coverage, application methods, and application temperature

#### **COVERAGE CHART/ESTIMATING GUIDE**

Number of 12' planks, does not include waste

COVERAGE AREA LESS OPENINGS		HARDIEPLANK SIDING WIDTH							
SQ (1 SQ = 100 sq.ft.)	Sq. Meters (1 SQ = 9.29)	(exposure)	5 1/4 4	6 1/4 5	7 1/4 6	7 1/2 6 1/4	8 6 3/4	8 1/4 7	
1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18	(9.29) (18.58) (27.87) (37.16) (46.45) (55.74) (65.03) (74.32) (83.61) (92.9) (102.19) (111.48) (120.77) (130.06) (139.35) (148.64) (157.93) (167.22) (176.51) (185.8)		25 50 75 100 125 150 175 200 225 250 275 300 325 350 425 450 475 500	20 40 60 80 100 120 140 160 180 220 240 260 280 300 320 340 360 380 400	17 33 50 67 83 100 117 133 150 167 183 200 217 233 250 267 283 300 317 333	16 32 48 64 80 96 112 128 144 160 176 192 208 224 240 256 272 288 304 320	15 30 44 59 74 89 104 119 133 148 163 178 193 207 222 237 252 267 281 296	14 29 43 57 71 86 100 114 129 143 157 171 186 200 214 229 243 257 271 286	

This coverage chart is meant as a guide. Actual usage is subject to variables such as building design. James Hardie does not assume responsibility for over or under ordering of product.

RECOGNITION: In accordance with ICC-ES Legacy Report NER-405, HardiePlank lap siding is recognized as a suitable alternate to that specified in: the BOCA National Building Code, the 1997 Standard Building Code, the 1997 Uniform Building Code, the 1998 International One- and Two-Family Dwelling Code, the 2003 International Building Code, and the 2003 International Residential Code for One- and Two-Family Dwellings. HardiePlank lap siding is also recognized for application in the following: City of Los Angeles Research Report No. 24862, State of Florida listing FL#889, Dade County, Florida NOA No. 02-0729.02, U.S. Dept. of HUD Materials Release 1263c, Texas Department of Insurance Product Evaluation EC-23, City of New York MEA 223-93-M, and California DSA PA-019. These documents should also be consulted for additional information concerning the suitability of this product for specific applications.





#### COMPLIANCE:

HardiePlank® lap siding complies with ASTM Specification C1186 (Grade II, Type A) and ISO Standard 8336 (Category 3, Type A).

When tested in accordance with CAN/ULC-S102, the product is recognized to have the following properties: Flame Spread Rating: 0, Smoke Developed Classification: 0.

When tested in accordance with CAN/ULC-S114, the product is recognized as noncombustible.

# **RECOGNITION:**

HardiePlank lap siding is recognized as an exterior wall cladding in CCMC Evaluation Report 12678-R. This document should also be consulted for additional information concerning the suitability of this product for specific applications. For technical assistance, call 1-800-9-HARDIE.


#### ADDITIONAL HANDLING REQUIREMENTS


IMPORTANT: To prevent damage to the drip edge, extra care should be taken when removing planks from the pallet, while handling, and when installing with a lap gauge. Planks are interlocked together on the pallet, therefore they should be removed from the pallet horizontally (side to side) to allow planks to unlock themselves from one another.

#### FIRE-RESISTIVE CONSTRUCTION:

HardiePlank lap siding is recognized as a component in 1-hour fire-related wall construction. Details of this assembly (Design No. JH/WA 60-04) may be found at: www.Intertek-ETLSemko.com





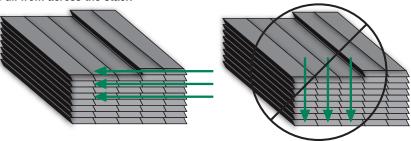

# WIND LOAD TABLE

Refer to CCMC Evaluation Report 12678-R for steel stud application.

NOMINAL PRODUCT THICKNESS WIDTH (mm)		FASTENER TYPE	NAILING	FRAME TYPES	MAXIMUM STUD SPACING	ULTIMATE LOAD @FAILURE kPa psf	
<190 (7.5")	7.5mm (5/16")	Min. 2.4 mm shank x 5.6 mm HD x 50 mm (2") long galvanized roofing nail	Through top edge of plank	Nominal 2x4 wood 2	406mm (16")	4.39	92
203 (8") 210 (8.25")	7.5mm (5/16")	Min. 2.4 mm shank x 5.6 mm HD x 50 mm (2") long galvanized roofing nail	Through top edge of plank	Nominal 2	406mm (16")	3.93	82
<241 (9.5") w/off stud/ splice	7.5mm (5/16")	No. 11 ga.x 9.5 mm HD x 32 mm (1 1/4") long galvanized roofing nail	Through top edge of plank	Nominal 2x4 wood 1	406mm (16") 610mm (24")	6.77 4.41	141 92
<241 (9.5")	7.5mm (5/16")	2.3 mm shank x 5.6 mm HD x 50 mm (2") long galvanized siding nail	Through Overlap	Nominal 2x4 wood 2	406mm (16")	5.08	106
<241 (9.5")	7.5mm (5/16")	6d common 50 mm long (2")	Through Overlap	Nominal 2x4 wood 1	406mm (16") 610mm (24")	9.53 4.50	199 94
305 (12")	7.5mm (5/16")	6d common 50 mm long (2")	Through Overlap	Nominal 2x4 wood 1	610mm (24")	3.60	75
<241 (9.5")	7.5mm (5/16")	38 mm (1 1/2") long with head dia. 5.7 mm and shank dia. 2.3 mm galvanized siding nails	Through Overlap	7/16" mm OSB rated sheathing	NA	3.45	72

# WIND LOAD TABLE FOOT NOTES:

- 1. Values are for species of wood having a specific gravity of 0.42 or greater.
- 2. Values are for species of wood having a specific gravity of 0.36 or greater.

METRIC TO IMPERIAL	<b>mm</b> 2.3	<b>inches</b> 3/32	mm	inches 5/16	mm	inches 1-1/4	<b>mm</b> 203	inches
CONVERSION TABLE	2.3 2.4	3/32 3/32	<b>7.5</b> 8.2	21/64	32 35	1-1/4	203	o 8-1/4
The following table provides a conversion of the nominal metric measurements presented in these installation instructions to nominal Imperial fraction measurement values	2.9 1/8 31 5.6 5.7 61 6.7	/8 7/32 7/32 5/64 17/64	92 9.5 11.1 12 19 25	3/64 3/8 7/16 15/32 3/4 1	38 41 50 91 150 190	1-1/2 1-5/8 2 3-5/8 6 7-1/2	241 305 406 610	9-1/2 12 16 24

© 2009 James Hardie International Finance B.V. All rights reserved. TM, SM, and ® denote trademarks or registered trademarks of James Hardie International Finance B.V. Si is a registered trademark of James Hardie International Finance B.V.

Additional Installation Information, Warranties, and Warnings are available at www.jameshardie.com

