
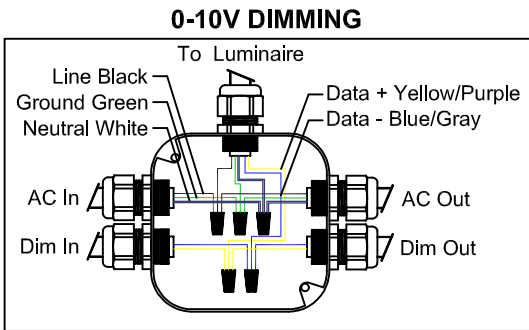
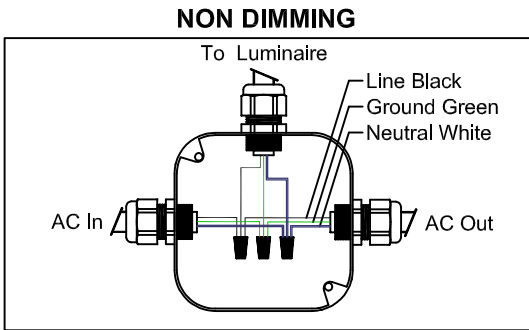
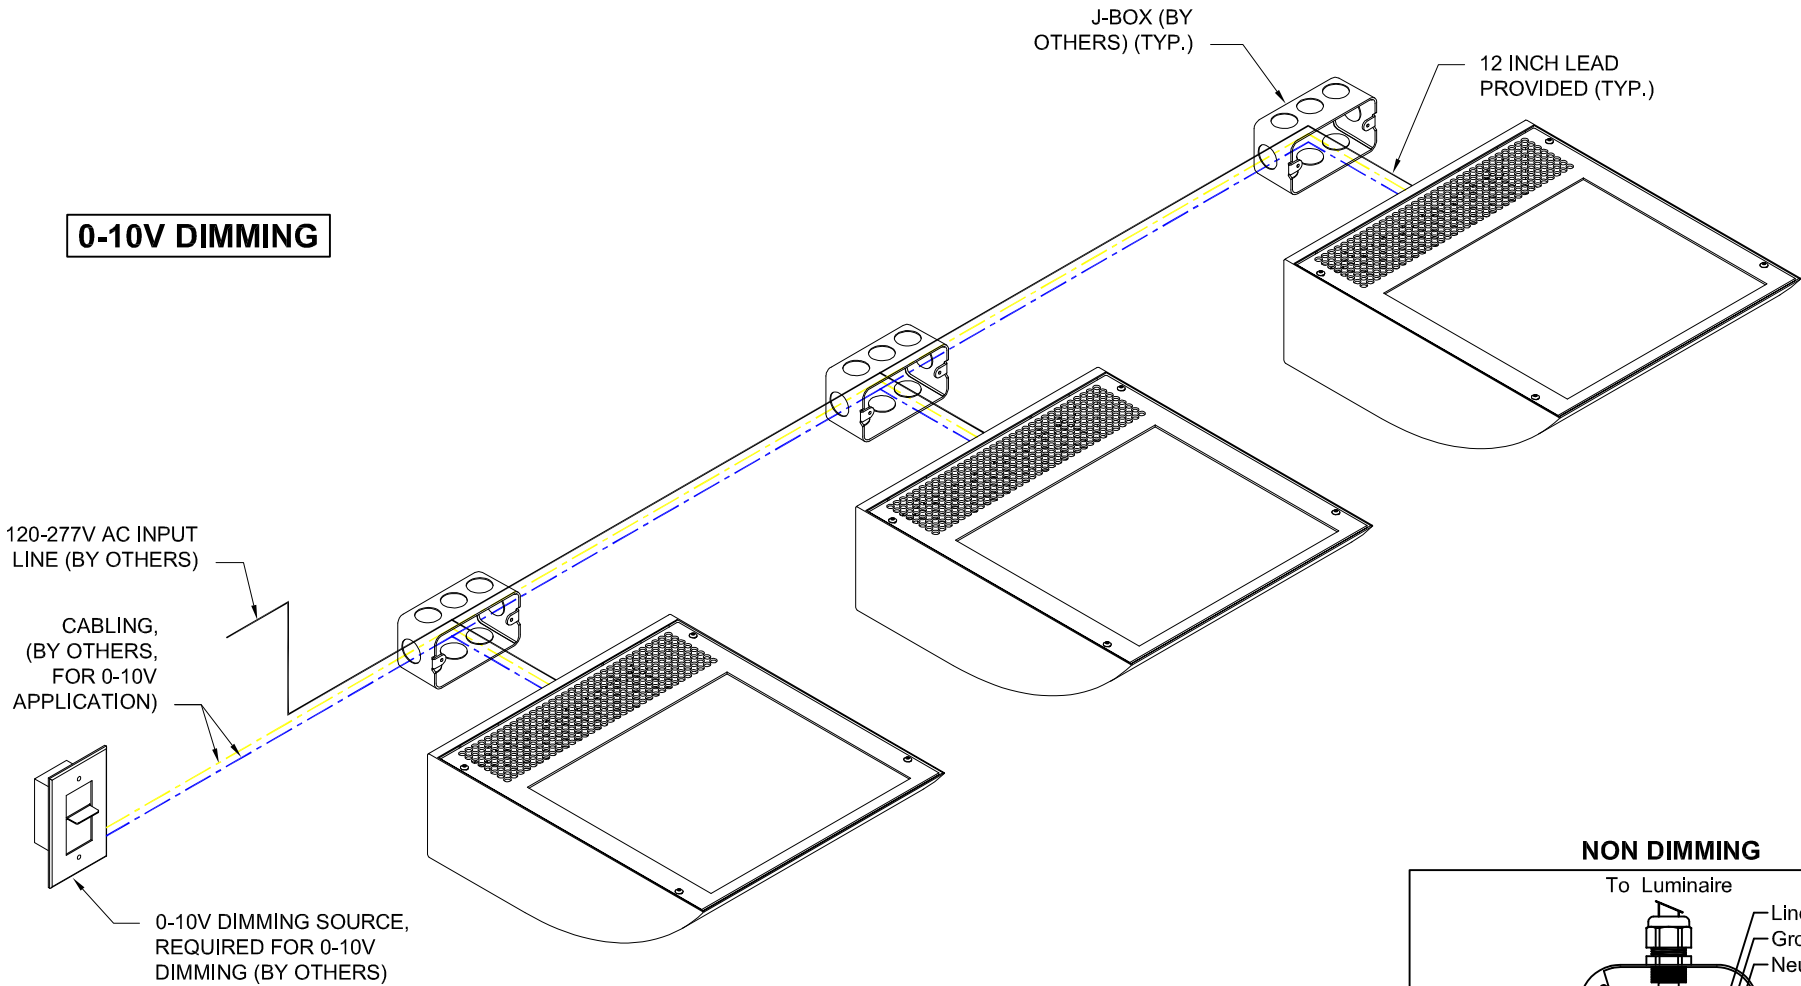


NOTE
SECONDARY CONNECTIONS
SHALL BE MADE IN ACCORDANCE
WITH NEC ARTICLE 725.

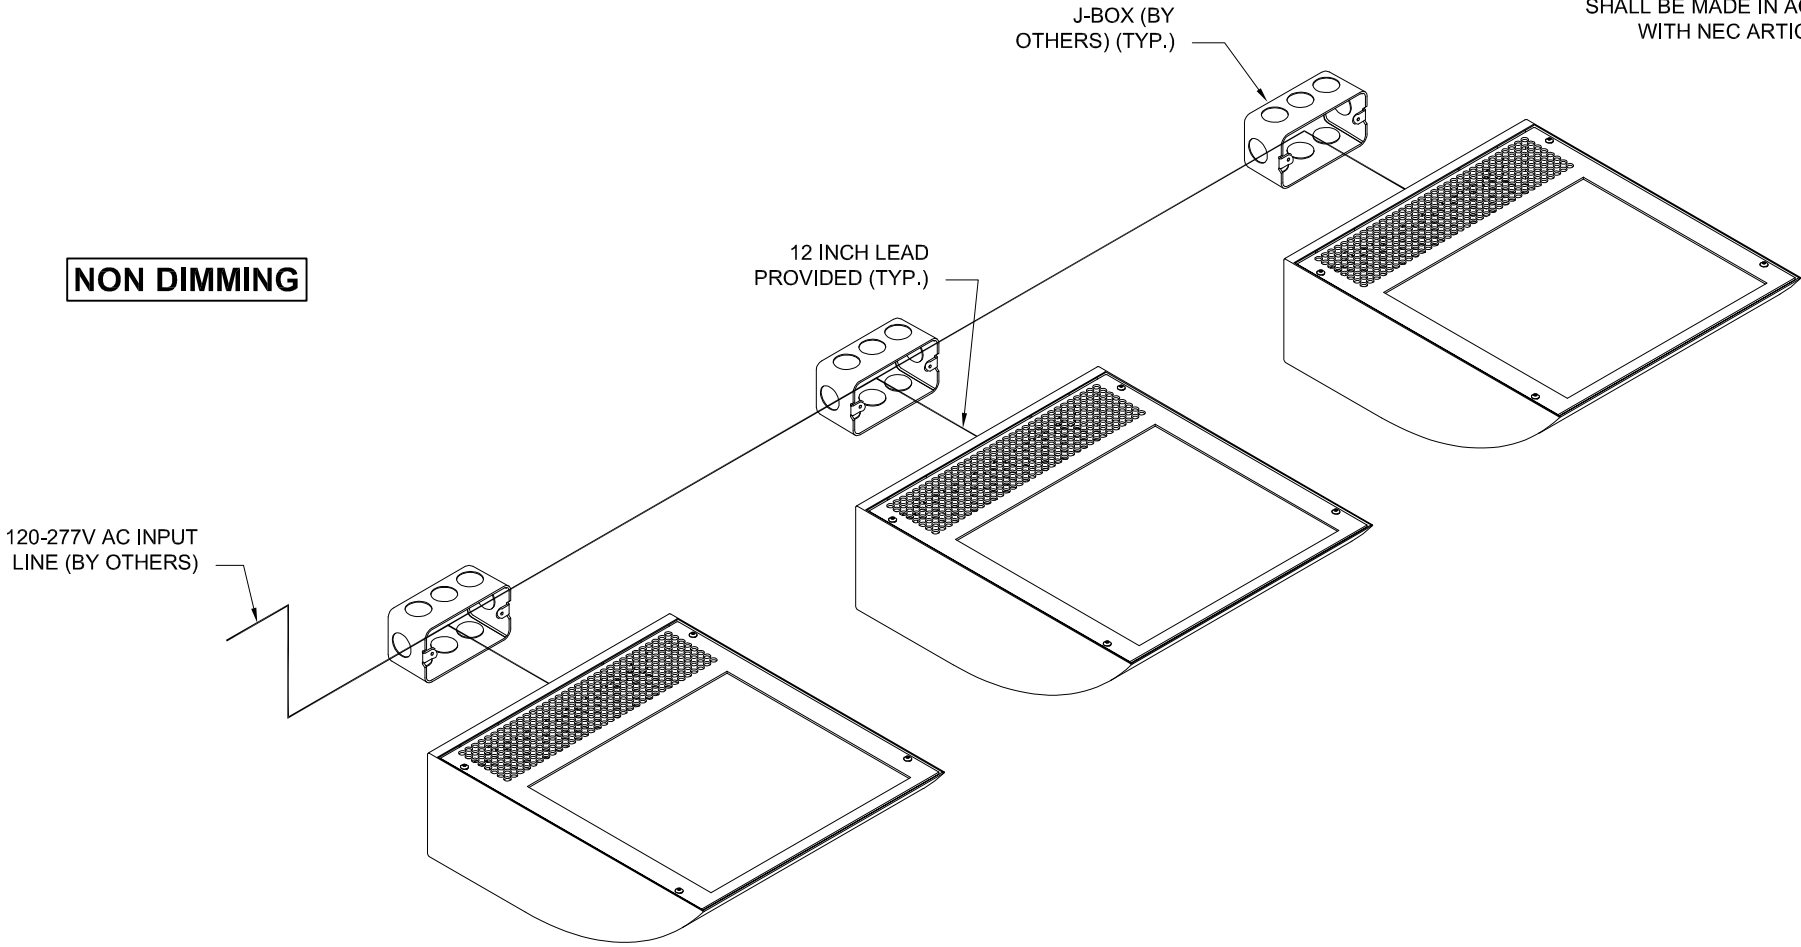

MAXIMUM FIXTURE TABLE			
	60 W/FXT	120 W/FXT	300 W/FXT
120 VAC 20 AMP Circuit	32 FXT	16 FXT	6 FXT
277 VAC 20 AMP Circuit	74 FXT	36 FXT	14 FXT
347 VAC 20 AMP Circuit	92 FXT	46 FXT	18 FXT
480 VAC 20 AMP Circuit	--	--	25 FXT

BLACK	WHITE	GREEN	BLUE/GRAY	YELLOW/PURPLE
LINE	NUETRAL	GROUND	DATA -	DATA +